












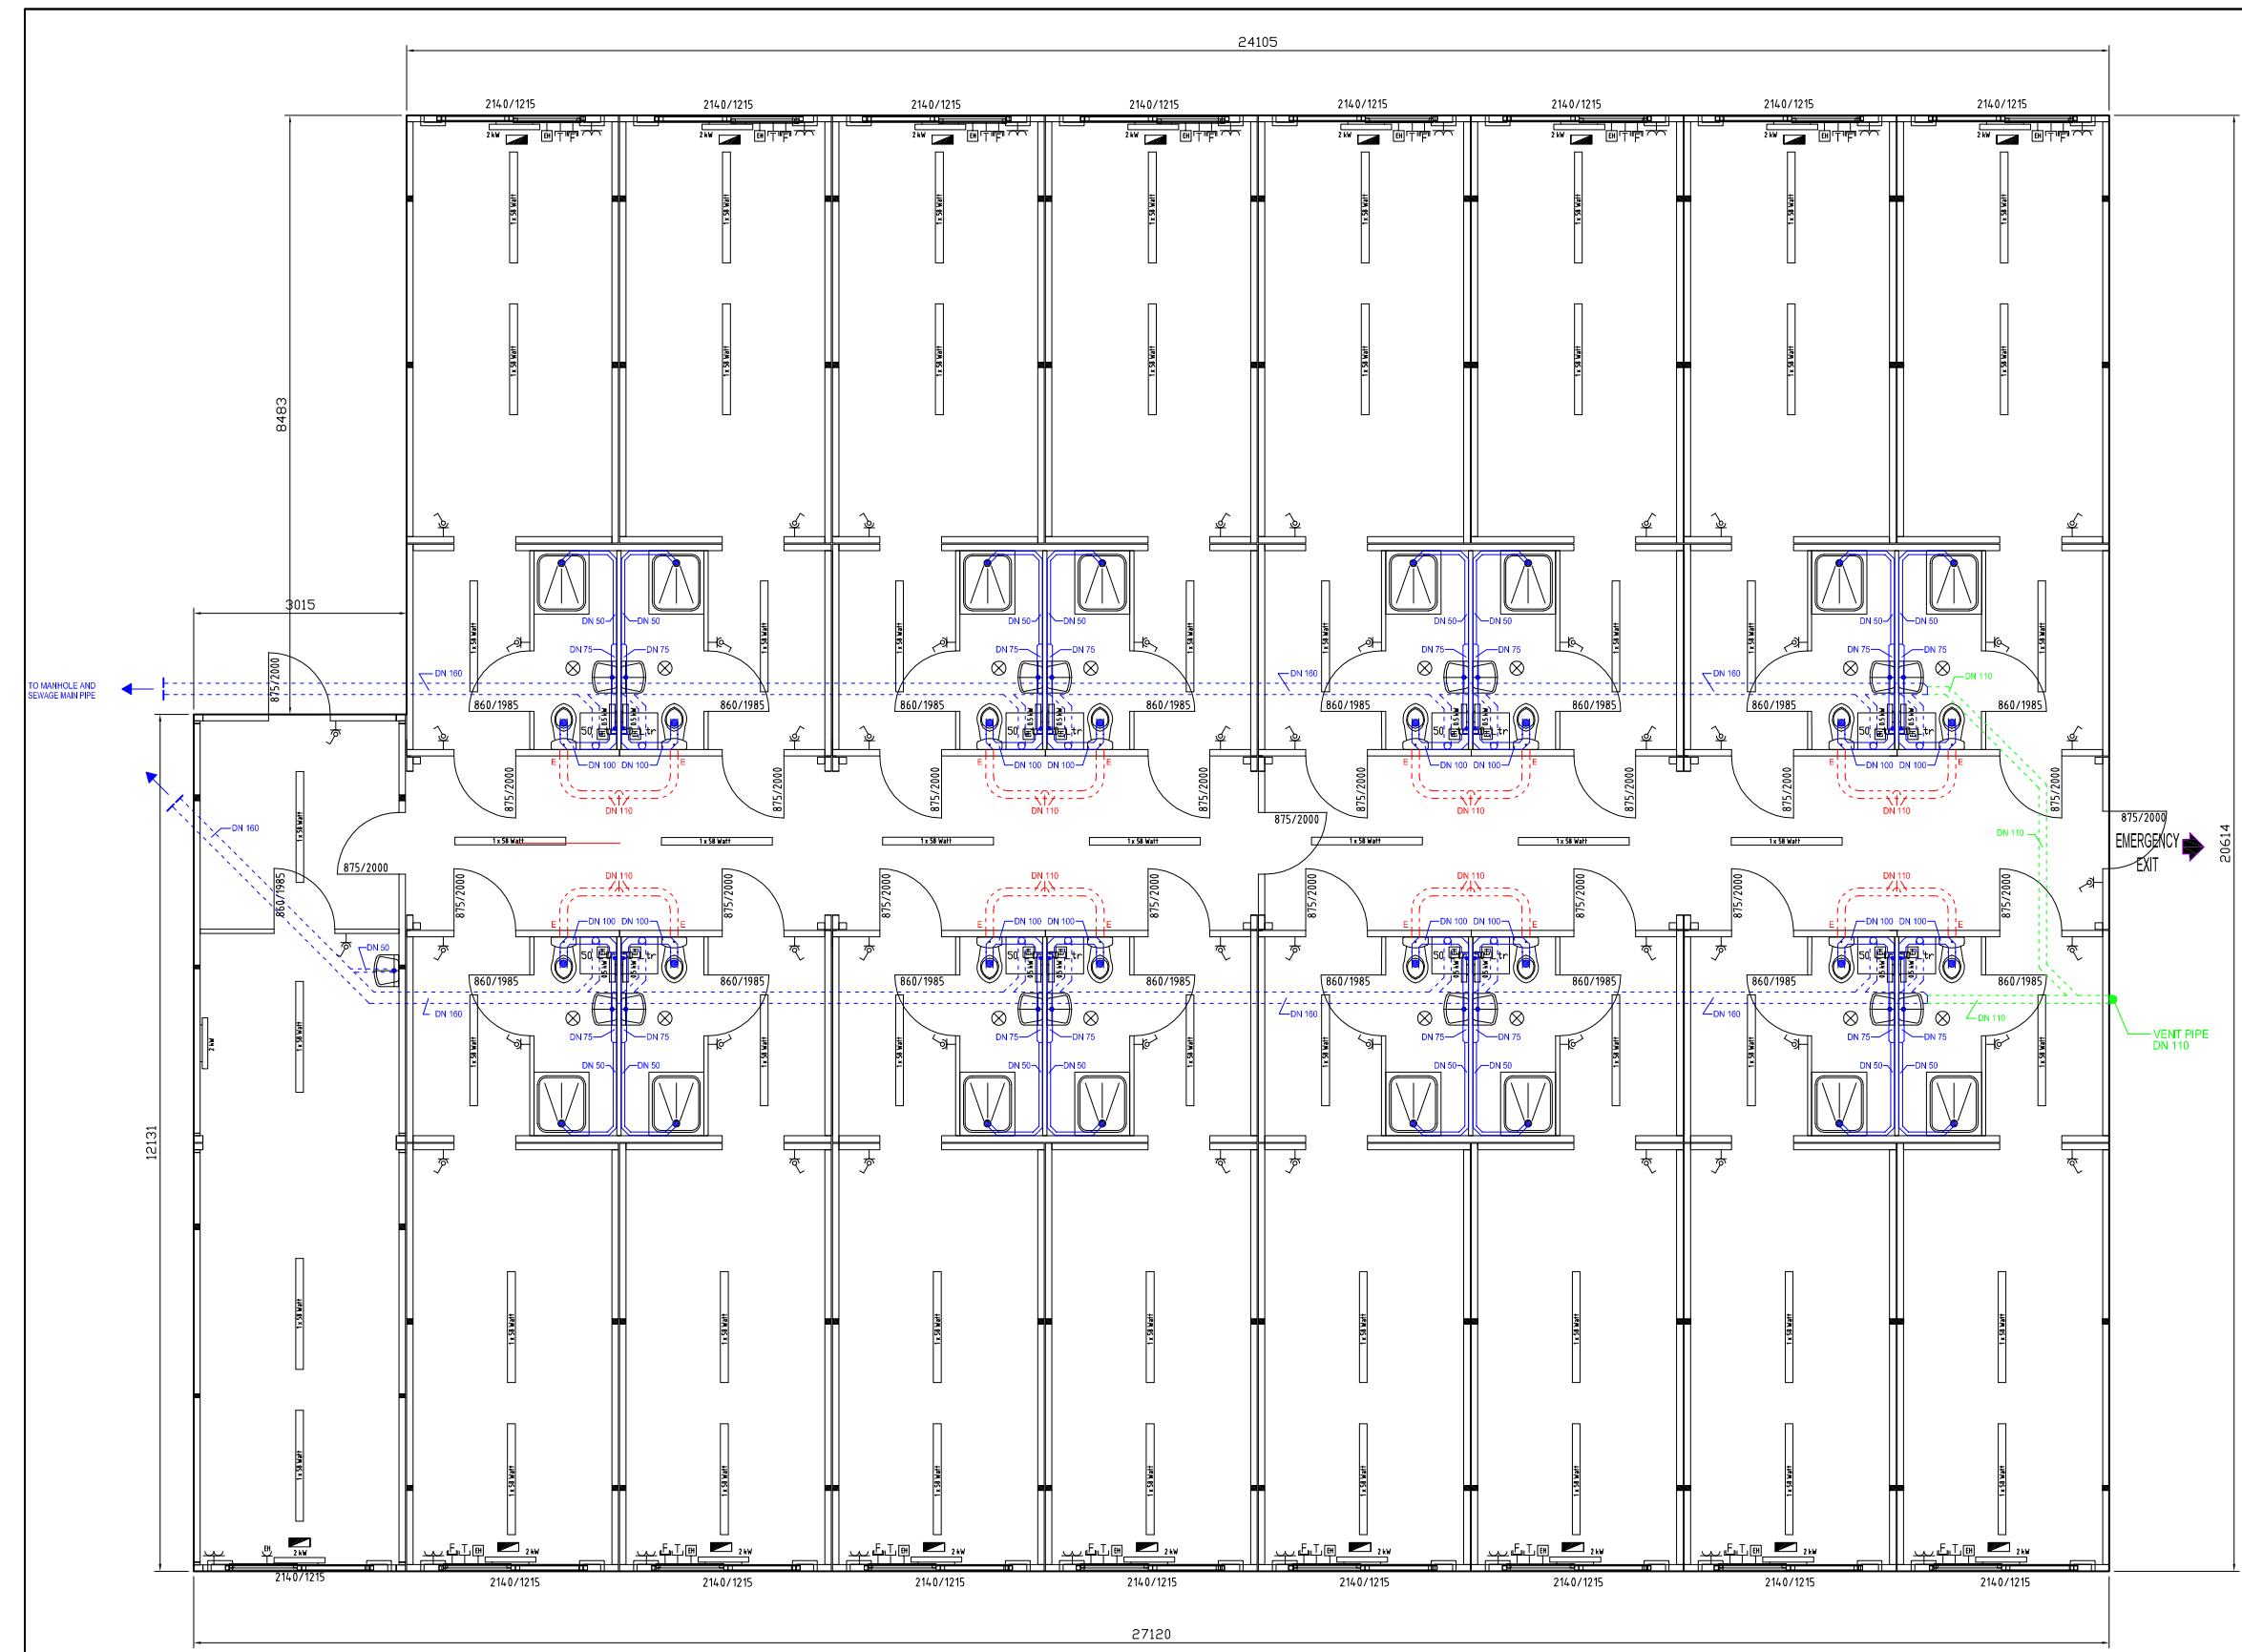


24105

### Key:

-  Electrical Panel
-  1 x 58 Watt Fluorescent Light
-  Light
-  2 kW Ventilator
-  Socket Heater
-  Double Socket
-  Socket + Light Switch
-  TV Socket
-  Telephone Connection
-  Extractor
-  Sewage Pipe visible above floor
-  Sewage Pipe invisible inside or under floor
-  Ventilation Pipe
- DN 75** Nominal Diameter of 75 mm



**LAYOUT - ACCOMMODATION BLOCK C**

SINGLE OCCUPANCY PER ROOM

1 x BLOCK TYPE C BUILDING 21

**COLOUR CODE:**

- Sewage
- Bathroom Ventilation
- Pipe Ventilation

01	ADD MISSING DETAILS INCLUDING SEWAGE AND PIPE VENTILATION	MOF	HIM	16.10.06	
REV	DESCRIPTION	DRAWN	CHKD	APPO	DATE

for Contractor's Technical Review (optional)


for Employer's Acceptance

for Construction Use


Confirmation As Built

Employer: \_\_\_\_\_ Contractor: \_\_\_\_\_ Designer's confirmation of the construction: \_\_\_\_\_

EMPLOYER



CONTRACTOR



Glendoe Joint Venture

c/o HOCHTIEF (UK) Construction Ltd.

Epiton

Windmill Hill Business Park

Whitehill Way, Swindon SN5 6NX

DATE	NAME
24.06.06	DMH
CHKD.	
APPRD.	

**Glendoe Hydro Project**

**CAMP**

**ACCOMMODATION BLOCK C**

**FIRE ALLARM SYSTEM**

SCOTTISH AND SOUTHERN ENERGY DRAWING NUMBER	IDENTIFIER	LOCATION	SUBJECT	SEQUENCE	SHEET	REV
HOCHTIEF GLENDOE JV DRAWING NUMBER	152	DT	90	00	02	42 01